



De Rondon 1
P.O. Box 6235
5600 HE Eindhoven
The Netherlands

www.tno.nl

T +31 40 265 00 00
F +31 40 265 03 02

TNO report

TQS-RAP-07-2412

Noval Glass Group LTD
EN12150: Thermally toughened soda lime silicate
safety glass
Thermally toughened soda lime silicate safety
glass

Date	September 24, 2007
Author(s)	L. van der Ven-le Comte
Assignor	Noval Glass Group LTD No.33 Shandong Road, Qingdao P.R.China Zip code: 266071 China
Project number	E07.0768
Number of pages	10 (incl. appendices)

All rights reserved. No part of this report may be reproduced and/or published in any form by print, photoprint, microfilm or any other means without the previous written permission from TNO.

All information which is classified according to Dutch regulations shall be treated by the recipient in the same way as classified information of corresponding value in his own country. No part of this information will be disclosed to any third party.

In case this report was drafted on instructions, the rights and obligations of contracting parties are subject to either the Standard Conditions for Research Instructions given to TNO, or the relevant agreement concluded between the contracting parties. Submitting the report for inspection to parties who have a direct interest is permitted.

Contents

1	Introduction	3
2	Experimental.....	4
2.1	Producer of the test samples	4
2.2	Product description.....	4
2.3	Tests	4
3	Results	6
3.1	General	6
3.2	Fragmentation test	6
3.3	Bending strength	8
4	Conclusion.....	9
5	Signature	10

1 Introduction

Noval Glass Group LTD has commissioned TNO Quality Services BV with the assessment of the performance of *thermally toughened glass as defined in EN12150-1*.

According to EN12150-2:2004 'Evaluation of conformity' an initial type testing of a thermally toughened glass product is aimed to establish if a product conforms to the definition of thermally toughened soda lime silicate safety glass.

An initial type testing concerns the product aspects, as listed below:

1. Mechanical strength measurements in accordance with EN12150 (EN1288-3)
2. Fragmentation test in accordance with EN12150

No reference of the product description was supplied by the manufacturer. This document shall be added to this initial type test report by the manufacturer. It was to the manufacturer's responsibility that the samples delivered for initial type test are representative to the production and normal production deviations were included in the delivered test samples.

If any deviation of applied materials/process/machines is encountered (and a so-called major change), re-type testing or additional tests may be required. This decision and responsibility belongs to the manufacturer. The product description is the lead for determining the window of these rules.

The following paragraphs describe the tests, the results and the conclusions.

2 Experimental

2.1 Producer of the test samples

Production plant of the samples : *Noval Glass Group LTD*

Sampling date : *23-09-2007*

Line ID where the samples are made : *Line #3*

Manufacturer:

Noval Glass Group LTD

No.33 Shandong Road, Qingdao P.R.China

Under responsibility of:

Noval Glass Group LTD

No.33 Shandong Road, Qingdao P.R.China

2.2 Product description

Product:	Thermally toughened soda lime silicate safety glass
Nominal thickness:	3; 4; 5; 6; 8; 10; 12; 15; 19 mm
Dimensions of tested glass specimens:	1100 x 360 mm
Number of test specimens:	45 (5 samples per thickness) Fragmentation test 10 samples per thickness EN1288-3

2.3 Tests

The executed type test consists of the following two tests:

- Mechanical strength measurement in accordance with EN12150 (EN1288-3)
- Fragmentation test in accordance with EN12150

The test samples are assumed to be float glass according to EN572 and manufactured in accordance of EN12150. The mechanical strength measurement requires a minimum of 10 samples and the fragmentation test requires 5 samples of a dimension of 360 by 1100 mm. The samples are tested according the requirements of EN12150 taking into account samples distribution schemes as specified in EN12150.

2.3.1 Mechanical strength measurement

The value of mechanical strength can only be given as a statistical value associated with a particular probability of breakage and with a particular type of loading. The mechanical strength values apply to quasi-static loading of the 95% confidence interval.

Type of glass	Values for mechanical strength (N/mm ²)
Float: Clear, Tinted and Coated	120
Enamelled float	75
Patterned glass and drawn sheet	90

The test is executed according EN1288 Part 3: Test with specimen supported at two points (four point bending).

2.3.2 Fragmentation test

The fragmentation test determines whether the glass breaks in the manner prescribed for a thermally toughened soda lime silicate safety glass. Each test specimen was impacted, using a pointed steel tool, at the prescribed position of the EN12150-1. Then, via a hammer and centre punch the glass is broken. In order to prevent scattering of the fragments the specimen is positioned in a frame. The frame is about 3-4 mm larger than the test specimen. The fragments remain interlocked after breakage yet extension of the specimen is not hindered. Between 4 and 5 minutes of the impact and within 1 minute the particle count has been done. The particle count is executed the region of coarsest fracture and outside the so-called excluded area like defined in the EN12150-1. The following table defines the minimal amount of the crack free within the mask of this assessment of 50 by 50 mm.

- 3 mm float shall result in minimal 15 particles.
- 4 mm up to and including 12 mm float shall result in minimal 40 particles.
- 15 mm up to and including 19 mm shall result in minimal 30 particles.

The following photos are examples of an assessment:

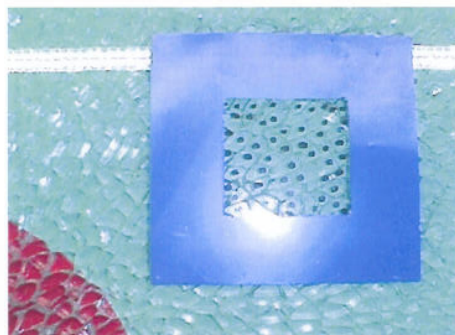


Photo 1: Typical example passing the requirements



Photo 2: typical example failing the requirements

3 Results

3.1 General

All samples have been tested by the China Safety Global Certification Center (CSGC) which is an approved test body and appointed by Certification and Accreditation of the P.R China (CNCA) and accredited by China National Accreditation Board for Certifiers (CNAB).

3.2 Fragmentation test

In the following table the results are given:

3mm clear tempered glass:Production line:#3

No.1		No.2		No.3		No.4		No.5	
Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)
47	19	59	17	53	23	64	24	42	22

Assessment between 4 and 5 minutes [Y / N] : Y

4mm **clear** tempered glass:Production line:#3

No.1		No.2		No.3		No.4		No.5	
Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)
58	17	53	18	82	8	52	15	49	14

5mm clear tempered glass:Production line:#3

No.1		No.2		No.3		No.4		No.5	
Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)
45	16	49	27	52	23	60	24	49	22

Assessment between 4 and 5 minutes [Y / N] : Y

6mm clear tempered glass:Production line:#3

No.1		No.2		No.3		No.4		No.5	
Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)
108	6	124	10	88	8	152	5	149	4

8mm clear tempered glass:Production line:#3

No.1		No.2		No.3		No.4		No.5	
Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)
128	7	124	6	134	5	129	6	142	5

Assessment between 4 and 5 minutes [Y / N] : Y

10mm clear tempered glass:Production line:#3

No.1		No.2		No.3		No.4		No.5	
Min. number of particles in 25cm ²	Length of particle(mm)	Min. number of particles in 25cm ²	Length of particle(mm)	Min. number of particles in 25cm ²	Length of particle(mm)	Min. number of particles in 25cm ²	Length of particle(mm)	Min. number of particles in 25cm ²	Length of particle(mm)
75	17	72	19	69	21	64	20	59	22

Assessment between 4 and 5 minutes [Y / N] : Y

12mm clear tempered glass:Production line:#3

No.1		No.2		No.3		No.4		No.5	
Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)
66	19	69	21	71	22	64	19	52	20

Assessment between 4 and 5 minutes [Y / N] : Y

15mm clear tempered glass: Production line: #3

No.1		No.2		No.3		No.4		No.5	
Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)
47	16	45	18	49	20	47	19	44	21
Assessment between 4 and 5 minutes [Y / N] : Y									

19mm clear tempered glass: Production line: #3

No.1		No.2		No.3		No.4		No.5	
Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)	Min. number of particles in 25cm ²	Length of longest particle(mm)
35	23	38	25	32	20	38	21	33	24
Assessment between 4 and 5 minutes [Y / N] : Y									

The conclusion is that the tested thicknesses are *passing* the requirements of the fragmentation test.

3.3 Bending strength

In the following table the results are given:

No.	Facing upwards or downwards	Thickness (mm)	Length (mm)	Width (mm)	Mech. Strength (N/mm ²)	Brake between rollers [Y/N]	Time to breakage (s)
1	NA	2.86	1100	360	150.6	Y	89
2	NA	2.88	1100	360	161.8	Y	91
3	NA	3.88	1100	360	193.5	Y	109
4	NA	3.85	1100	360	153.8	Y	105
5	NA	4.89	1100	360	185.9	Y	100
6	NA	4.88	1100	360	194.1	Y	122
7	NA	5.85	1100	360	183.7	Y	103
8	NA	5.86	1100	360	200.6	Y	103
9	NA	9.86	1100	360	241.8	Y	129
10	NA	9.86	1100	360	243.5	Y	135
11	NA	14.64	1100	360	193.8	Y	89
12	NA	14.70	1100	360	158.9	Y	81
13	NA	18.67	1100	360	166.6	Y	97
14	NA	18.60	1100	360	128.4	Y	99

The conclusion is that the results are *passing* the requirements of the mechanical strength.

4 Conclusion


All aspects are checked to establish if the *thermally toughened soda lime silicate safety glass* product of Noval Glass Group LTD conforms to the definition of soda lime silicate safety glass.

The mechanical strength and the fragmentation test *fulfil* the requirements mentioned in EN12150 for soda lime silicate safety glass products.

When and if changes are made in production method and/or equipment, assessment according the EN12150 shall be reconsidered and re-test shall be done when the changes can lead to different toughening of the glass. The decision and responsibility lies at the producer.


5 Signature

Eindhoven, September 2007



L. van der Ven-le Comte
Author

TNO Quality Services BV

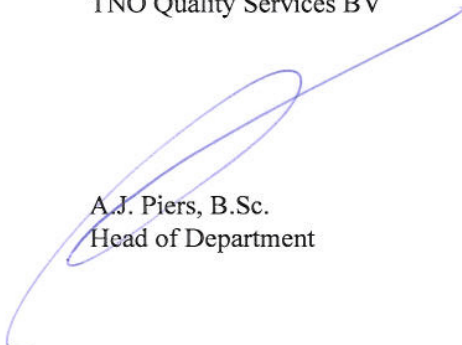

A.J. Piers, B.Sc.
Head of Department



TNO Quality Services BV
P.O. Box 6235
5600 HE Eindhoven
The Netherlands
Lab.no. 1750

Summary of report

Date: 9-24-2007

EN 12150
Thermally toughened soda lime silicate safety glass

for details, see test report

Producer: Noval Glass Group LTD
No.33 Shandong Road, Qingdao P.R.China

Under responsibility of: Noval Glass Group LTD
No.33 Shandong Road, Qingdao P.R.China

Product:
Thermally toughened soda lime silicate safety glass
(3; 4; 5; 6; 8; 10; 12; 15; 19 mm)

Test Result:

PASS

The tested samples are complying with the requirements of EN12150.

Signature:

A handwritten signature in blue ink, appearing to read 'L. van der Ven - le Comte'.

L. van der Ven - le Comte
Project leader

A handwritten signature in blue ink, appearing to read 'A.J. Piers'.

A.J. Piers
Programme leader